STEP #1:

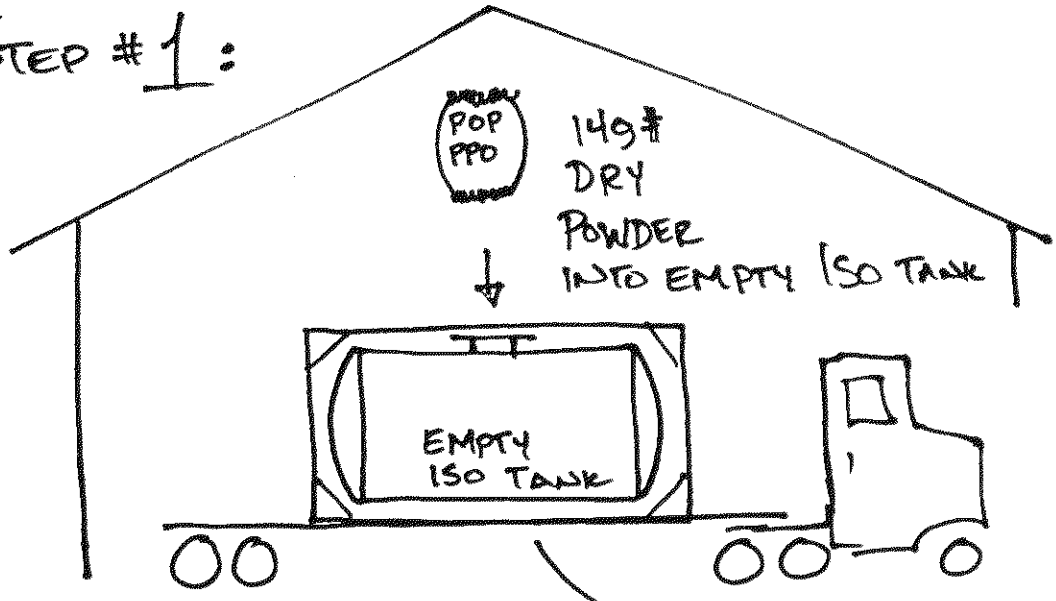

STEP #2:

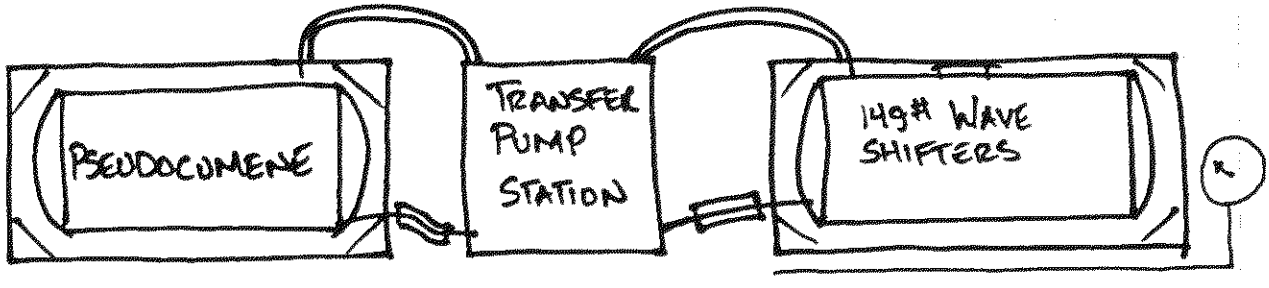

CONNECT ISO TANK TO TRANSFER PUMP STATION
TRANSFER 750 GALLONS OF PSEUDOCUMENE
TO ISO TANK @ ≈ 150 GPM -
20 MINUTE DURATION

USE A SCALE TO WEIGH AMOUNT OF
LIQUID TRANSFERED.