NOVA APD-TEC COOL'G W/REFRIGERANT	9-20-2006	DANE PUSHKA

SCHEMATIC DIAGRAM FOR 1/2 OF ONE 31 PLANE BLOCK

LOCATE CONDENSOR HIGH TO BE SURE TXV GET SUB-COOLED LIQUID @ INLET.

COOLS HALF OF VERTICAL MODULES IN ON BLOCK - 96 APD-TEC UNITS

1 MODULE SPACING

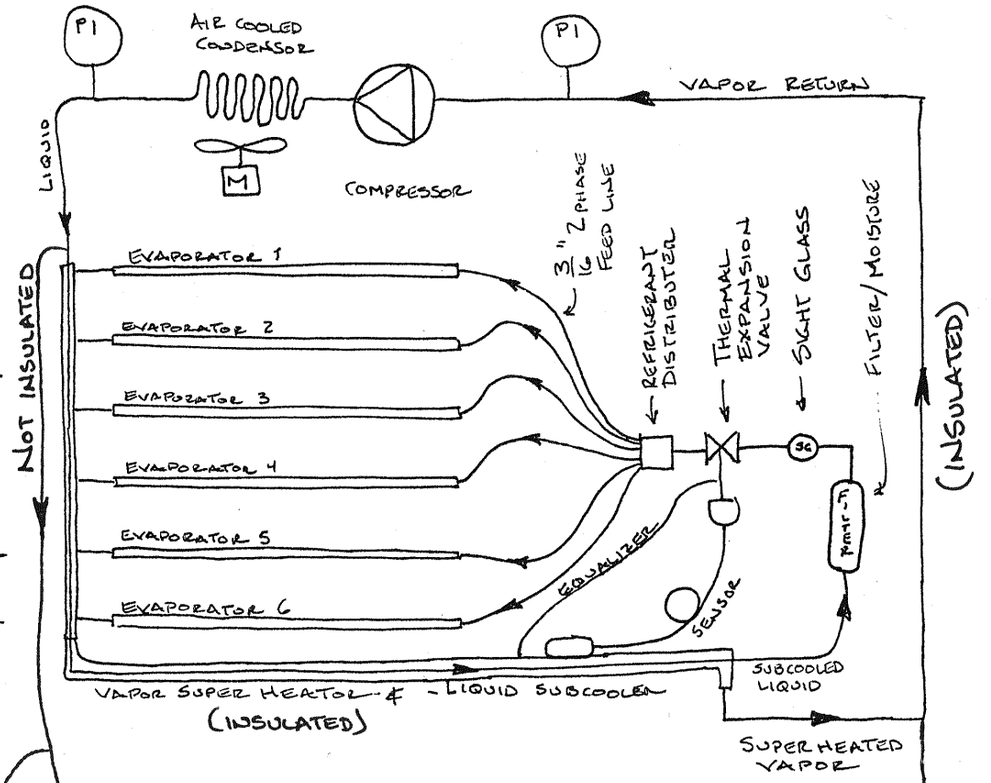

COOLS HALF OF HORZ MODULES ON ONE SIDE ONE ONE BLOCK - 42 OR 48 APD-TEC UNITS

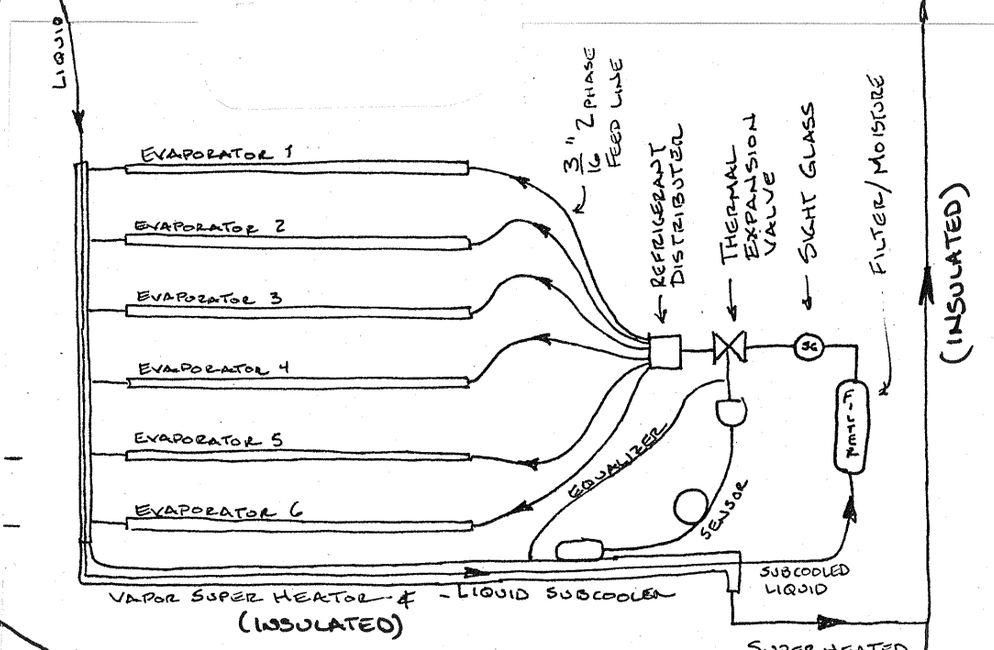
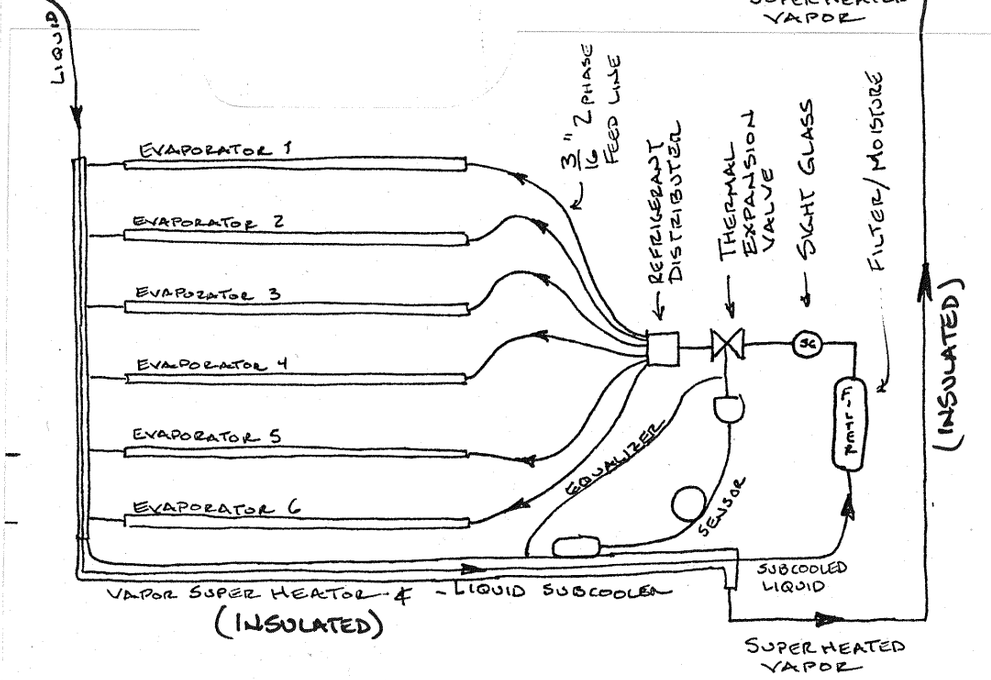
COOLS HALF OF HORIZ MODULES ON ONE BLOCK ON ONE SIDE - 42 OR 48